



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY, FLORIDA
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

Lawson Industries, Inc.
8501 NW 90th Street
Medley, FL 33166

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/ or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "4200/ 6200 Flange-Frame" Aluminum Fixed Window - L.M.I.

APPROVAL DOCUMENT: Drawing No. L4200-6200-1201, titled "Series-4200-6200 Flange-Frame Impact Fixed Window", sheets 01 through 05 of 05, dated 02/21/12 with revision "B" dated 05/12/17, prepared by manufacturer, signed and sealed by Thomas J. Sotos, P. E., bearing the Miami-Dade County Product Control Section Revision stamp with the Notice of Acceptance number and Expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/ or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises and renews** NOA No. 14-0908.18 and consists of this page 1 and evidence pages E-1, E-2 and E-3, as well as approval document mentioned above.

The submitted documentation was reviewed by **Jorge M. Plasencia, P. E.**



Jorge M. Plasencia
08/07/2017

NOA No. 17-0531.05
Expiration Date: August 22, 2022
Approval Date: August 17, 2017
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
(Submitted under NOA No. 12-0307.06)
2. Drawing No. **L4200-6200-1201**, titled "Series-4200-6200 Flange Frame Impact Fixed Window", sheets 01 through 05 of 05, dated 02/21/12 with revision "B" dated 05/12/17, prepared by manufacturer, signed and sealed by Thomas J. Sotos, P. E.

B. TESTS

1. Test reports on: 1) Large Missile Impact Test per FBC, TAS 201-94
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of an arch- and a rectangular fin-frame fixed window, prepared by Hurricane Engineering & Testing, Inc., Test Reports No.'s **HETI-12-4010** and **HETI-11-3363**, both dated 03/05/12, signed and sealed by Rafael Droz-Seda, P. E.
(Submitted under NOA No. 12-0307.06)
2. Test reports on: 1) Large Missile Impact Test per FBC, TAS 201-94
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of a rectangular-, a circular arch- and an elliptical arch fin-frame fixed window, prepared by Hurricane Engineering & Testing, Inc., Test Reports No.'s **HETI-09-2614**, dated 09/04/09, **HETI-09-2612**, dated 09/02/09, **HETI-09-2586**, dated 07/10/09, **HETI-09-2584**, dated 07/10/09, **HETI-09-2582**, dated 07/10/09, **HETI-09-2580** and dated 07/10/09, all signed and sealed by Candido F. Font, P. E.
(Submitted under NOA No. 12-0307.06)
3. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
along with marked-up drawings and installation diagram of a rectangular fin-frame fixed window, prepared by Hurricane Engineering & Testing, Inc., Test Reports No.'s **HETI-09-2613**, dated 09/04/09, **HETI-09-2611**, dated 09/04/09, **HETI-09-2585**, dated 07/10/09, **HETI-09-2581**, dated 07/10/09 and **HETI-09-2579**, dated 07/10/09, all signed and sealed by Candido F. Font, P. E.
(Submitted under NOA No. 12-0307.06)
4. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
along with marked-up drawings and installation diagram of a rectangular fin-frame fixed window, prepared by Hurricane Engineering & Testing, Inc., Test Reports No.'s **HETI-03-1778**, dated 01/30/03, **HETI-03-1779**, dated 01/30/03 and **HETI-03-1776**, dated 01/30/03, all signed and sealed by Rafael Droz-Seda, P. E.
(Submitted under NOA No. 03-0327.11)



Jorge M. Plasencia, P. E.
Product Control Unit Supervisor
NOA No. 17-0531.05
Expiration Date: August 22, 2022
Approval Date: August 17, 2017

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

B. TESTS (CONTINUED)


5. Test reports on: 1) Large Missile Impact Test per FBC, TAS 201-94
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of a rectangular-, a circular arch- and an elliptical arch fin-frame fixed window, prepared by Hurricane Engineering & Testing, Inc., Test Reports No.'s **HETI-03-1777**, dated 01/30/03, **HETI-03-1774A** and dated 01/30/03, **HETI-03-1774B**, dated 01/30/03, all signed and sealed by Rafael Droz-Seda, P. E.
(Submitted under NOA No. 03-0327.11)
6. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
along with marked-up drawings and installation diagram of a circular arch fin-frame fixed window, prepared by Hurricane Engineering & Testing, Inc., Test Reports No.'s **HETI-02-1215**, dated 04/08/02 and **HETI-01-1193**, dated 04/08/02, both signed and sealed by Hector Medina, P. E.
(Submitted under NOA No. 02-0701.01)
7. Test reports on: 1) Large Missile Impact Test per FBC, TAS 201-94
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of a rectangular-, a circular arch- and an elliptical arch fin-frame fixed window, prepared by Hurricane Engineering & Testing, Inc., Test Reports No.'s **HETI-02-1158**, dated 04/08/02, **HETI-01-1103**, dated 02/12/02 and **HETI-01-1098**, dated 02/11/02, all signed and sealed by Hector Medina, P. E.
(Submitted under NOA No. 02-0701.01)

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC, prepared by manufacturer, dated 03/01/12, signed and sealed by Thomas J. Sotos, P. E.
(Submitted under NOA No. 12-0307.06)
2. Glazing complies with ASTM E1300-04/ 09

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER).



Jorge M. Plasencia, P. E.
Product Control Unit Supervisor
NOA No. 17-0531.05
Expiration Date: August 22, 2022
Approval Date: August 17, 2017

Lawson Industries, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **16-1117.01** issued to **Kuraray America., Inc.** for their “**Trosifol® Ultraclear, Clear, and Color PVB Interlayers**” dated 01/19/17, expiring on 07/08/19.
2. Notice of Acceptance No. **14-0916.11** issued to **Kuraray America., Inc.** for their “**SentryGlas® (Clear and White) Interlayer**” dated 06/25/15, expiring on 07/04/18.
3. Notice of Acceptance No. **14-0423.15** issued to **Eastman Chemical Company (MA)** for their “**Saflex CP – Saflex and Saflex HP Composite Glass Interlayers with PET Core**” dated 06/19/14, expiring on 12/11/18.

F. STATEMENTS

1. Statement letter of conformance to and complying with **FBC 5th Edition (2014)**, issued by manufacturer, dated 05/23/17, signed and sealed by Thomas J. Sotos, P. E.
2. Statement letter of no financial interest, issued by manufacturer, dated 03/02/12, signed and sealed by Thomas J. Sotos, P. E.
(Submitted under NOA No. 12-0307.06)
3. Laboratory compliance letter for Test Reports No.’s **HETI-09-2614**, dated 09/04/09, **HETI-09-2612**, dated 09/02/09, **HETI-09-2586**, dated 07/10/09, **HETI-09-2584**, dated 07/10/09, **HETI-09-2582**, dated 07/10/09, **HETI-09-2580**, dated 07/10/09, **HETI-09-2613**, dated 09/04/09, **HETI-09-2611**, dated 09/04/09, **HETI-09-2585**, dated 07/10/09, **HETI-09-2581**, dated 07/10/09 and **HETI-09-2579**, dated 07/10/09, all issued by Hurricane Engineering & Testing, Inc., signed and sealed by Candido F. Font, P. E.
(Submitted under NOA No. 12-0307.06)
4. Laboratory compliance letter for Test Reports No.’s **HETI-12-4010** dated 03/05/12, **HETI-11-3363**, dated 03/05/12, **HETI-03-1778**, dated 01/30/03, **HETI-03-1779**, dated 01/30/03, **HETI-03-1776**, dated 01/30/03, **HETI-03-1777**, dated 01/30/03, **HETI-03-1774A**, dated 01/30/03 and **HETI-03-1774B**, dated 01/30/03, all issued by Hurricane Engineering & Testing, Inc., signed and sealed by Rafael Droz-Seda, P. E.
(Submitted under NOA’s No.’s 12-0307.06)

G. OTHERS

1. Notice of Acceptance No. **14-0908.18**, issued to Lawson Industries, Inc. for their Series “**4200/ 6200 Flange-Frame**” Aluminum Fixed Window – **L.M.I.**”, approved on 12/11/14 and expiring on 08/22/17.




Jorge M. Plasencia, P. E.
Product Control Unit Supervisor
NOA No. 17-0531.05
Expiration Date: August 22, 2022
Approval Date: August 17, 2017

SERIES-4200 / 6200 FIXED IMPACT WINDOW - FLANGE FRAME

APPROVED WINDOW ELEVATIONS (L.M.IMPACT)

| | | |
|--|--|---|
| <p>WINDOW HEIGHT</p> <p>WINDOW WIDTH</p> <p>QUARTER-ROUND ELEVATION</p> | <p>WINDOW HEIGHT</p> <p>WINDOW WIDTH</p> <p>HALF-ROUND TYPICAL ELEVATION</p> | <p>WINDOW HEIGHT</p> <p>LEG HT.</p> <p>WINDOW WIDTH</p> <p>ARCHED PICTURE WINDOW</p> |
| <p>WINDOW HEIGHT</p> <p>WINDOW WIDTH</p> <p>HEXAGON TYPICAL ELEVATION</p> | <p>WINDOW HEIGHT</p> <p>WINDOW WIDTH</p> <p>RECTANGULAR TYPICAL ELEVATION</p> | <p>WINDOW HEIGHT</p> <p>WINDOW WIDTH</p> <p>SQUARE PICTURE WINDOW ELEVATION</p> |
| <p>WINDOW HEIGHT</p> <p>WINDOW WIDTH</p> <p>FULL ROUND TYPICAL ELEVATION</p> | <p>WINDOW HEIGHT</p> <p>WINDOW WIDTH</p> <p>RECTANGULAR TYPICAL ELEVATION</p> | <p>WINDOW HEIGHT</p> <p>LEG HT.</p> <p>WINDOW WIDTH</p> <p>SQUARE PICTURE WINDOW ELEVATION</p> |
| <p>WINDOW HEIGHT</p> <p>WINDOW WIDTH</p> <p>OVAL TYPICAL ELEVATION</p> | <p>WINDOW HEIGHT</p> <p>WINDOW WIDTH</p> <p>LEG HT.</p> <p>LEGGED EYE BROW ELEVATION</p> | <p>WINDOW HEIGHT</p> <p>WINDOW WIDTH</p> <p>QUARTER-ROUND ELEVATION</p> |
| <p>WINDOW HEIGHT</p> <p>WINDOW WIDTH</p> <p>OCTAGON TYPICAL ELEVATION</p> | <p>WINDOW HEIGHT</p> <p>WINDOW WIDTH</p> <p>"ELLIPTICAL" TYPICAL ELEVATION</p> | <p>ALLOWABLE LOADS FOR ALTERNATE SHAPES AS SHOWN, CAN BE VERIFIED BY INSCRIBING PICTURE WINDOW SHAPE WITHIN A SQUARE OR RECTANGLE, AS SHOWN IN DOTTED LINES AND OBTAINING ALLOWABLE LOADS FROM THOSE SHAPES. PROVIDED PERIMETER FASTENERS ARE AS DESCRIBED HEREIN FOR SIZE AND SPACING.</p> |

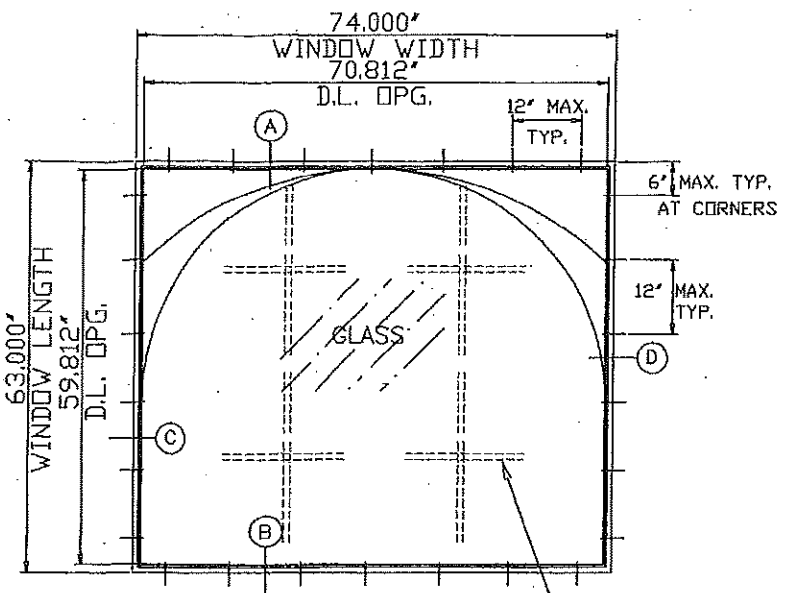

TYPICAL ELEVATION TESTED UNIT

EXT. & INT. FALSE COLONIAL MUNTINS ARE APPLIED W/ W/ SILICONE AND ARE AVAILABLE AS OPTIONAL.

NOTE:
 MAXIMUM GLASS AREA TESTED APPLIES TO GLASS TYPES: E, F, J, K AND L. - SEE DESIGN LOAD CAPACITY TABLES ON SHEET 4 FOR SIZE LIMITATIONS OF EACH GLASS TYPE.

WINDOWS ARE L.M. IMPACT MIAMI-DADE COUNTY APPROVED SHUTTERS NOT REQUIRED

PRODUCT REVISED
 as complying with the Florida Building Code
 NOA-No. **17-0531.05**
 Expiration Date **08/22/2022**
 By *[Signature]*
 Miami-Dade Product Control

General Notes:

- 1.) THIS WINDOW SYSTEM IS DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE 2014 FLORIDA BUILDING CODE 5th Edition INCLUDING HIGH VELOCITY HURRICANE ZONE VELOCITY (HVHZ) AND ASTM 1300-09. THIS PRODUCT IS IMPACT RESISTANT. (SHUTTERS NOT REQUIRED)
- 2.) WOOD BUCKS SHALL BE INSTALLED AND ANCHORED SO THAT THE BUILDING RESISTS THE SUPERIMPOSED LOADS IN ACCORDANCE WITH THE REQUIREMENTS OF 2014 F.B.C. & TO BE REVIEWED BY BUILDING OFFICIAL.
- 3.) ANCHORS SHOWN ABOVE ARE AS PER TEST UNITS. ANCHORS ON ALL WINDOW SIZES ARE NOT TO EXCEED THESE MAXIMUM SPACINGS ON CENTER (O.C.)
- 4.) ANCHOR CONDITIONS NOT DESCRIBED IN THESE DRAWING'S ARE TO BE ENGINEERED ON A SITE SPECIFIC BASIS, UNDER SEPARATE APPROVAL AND TO BE REVIEWED BY BUILDING OFFICIAL.
- 5.) WINDOWS ARE QUALIFIED FOR USE WITH SINGLE GLAZE LAMINATED GLASS TYPES, AND FOR USE WITH DOUBLE GLAZE LAMINATED INSULATED GLASS TYPES TABULATED HEREIN; (SEE SHEET #3 FOR GLASS TYPES AND SHEET #4 FOR MAX. DESIGN PRESSURES).
- 6.) WINDOWS WITH GLASS TYPES "B, C, F, OR G" INSTALLED ABOVE 30ft. IN THE HVHZ, THE I.G. EXTERIOR LITE SHALL BE TEMPERED TO COMPLY WITH THE SMALL MISSILE IMPACT RESISTANCE REQUIREMENTS (FBC-2014, Section 2411.3.3.7).
- 7.) FOR OPTIONAL FRAME INSTALLATION DETAILS SEE SHEETS 2 & 5.
- 8.) EXT. & INT. FALSE COLONIAL MUNTINS ARE OPTIONAL & AND ARE APPLIED W/ SILICONE
- 9.) WOOD BUCKS IN CONTACT WITH CONCRETE MUST BE PRESSURE TREATED AND ANCHORED (BY OTHERS), PRIOR TO WINDOW INSTALLATION. (SEE SHEET #2 FOR DETAIL & NOTES)
- 10.) APPROVAL APPLIES TO SINGLE UNITS OR SIDE BY SIDE MULLED UNITS.
- 11.) MULLING FIXED WINDOWS WITH OTHER TYPES OF MIAMI-DADE COUNTY APPROVED PRODUCTS USING A MIAMI-DADE COUNTY APPROVED MULLION IN BETWEEN ARE ACCEPTABLE BUT THE LOWER DESIGN PRESSURE FROM THE WINDOWS OR MULLION APPROVAL WILL APPLY TO THE ENTIRE MULLED SYSTEM.
- 12.) SEE SHEET # 5 FOR MULLION/METAL ATTACHMENT DETAILS & OPTIONS.


LAWSON INDUSTRIES, INC.

8501 N.W. 90 ST.
 MEDLEY, FLORIDA 33166
 PH No. (305) 696-8660

| | |
|--|--|
| Revision Notes: A. Revised date for the 2014 FBC B. Compliance w/ FBC 5th Edition (2014) and ASTM E1300-09 | Date Drawn: 02-21-12 Date Revised: 05/12/17 Scale: B |
| Drawn By: N. ERAZO | Revised By: N. ERAZO |
| Product Reference Number: L4200-6200-1201 | Sheet: 1 OF 6 |

THOMAS W. SOTOS
 PROFESSIONAL ENGINEER
 LICENSE # 55225
 STATE OF FLORIDA
 PROFESSIONAL SEAL

MANUFACTURER OF QUALITY ALUMINUM WINDOWS AND GLASS DOORS
SERIES-4200-6200 FLANGE FRAME IMPACT FIXED WINDOW
 APPROVED ELEVATIONS, CONFIGURATIONS AND NOTES

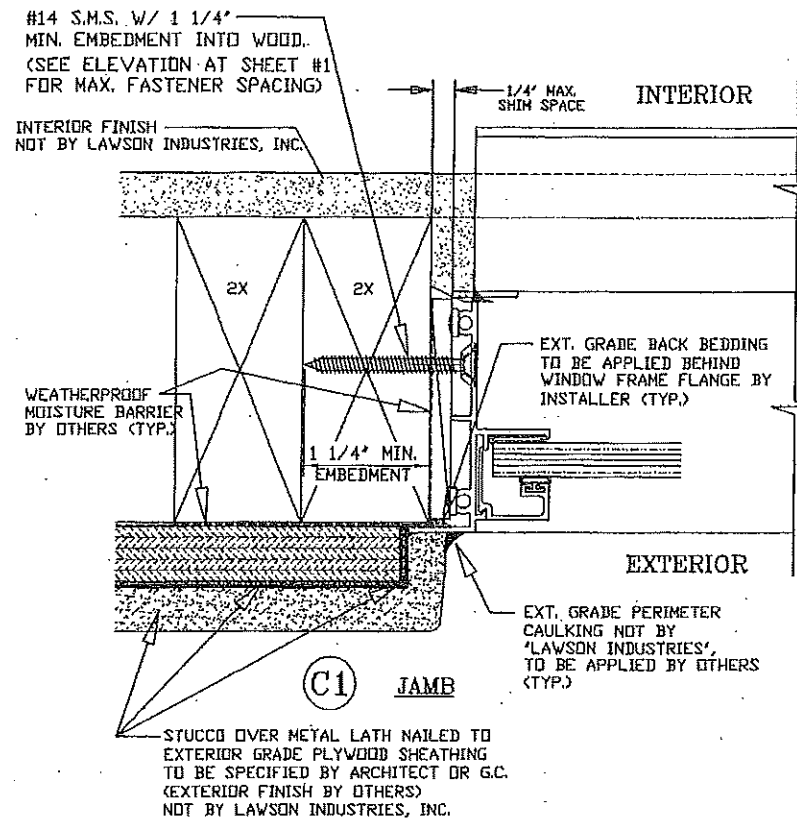

WOOD FRAME INSTALLATION DETAIL

PRODUCT REVISED
 as complying with the Florida
 Building Code
 NOA-No. **17-0531.05**
 Expiration Date **08/22/2022**
 By *[Signature]*
 Miami-Dade Product Control

WINDOW INSTALLATION NOTES:




1. THE WINDOW FRAME FLANGE TO BE BACK-BEDDED W/ AN EXT. GRADE CAULK THROUGHOUT THE ENTIRE PERIMETER OF FLANGE BY WINDOW INSTALLER (TYP.)
 2. THE EXPOSED EXT. PERIMETER OF THE WINDOW FRAME TO BE CAULKED AND SEALED W/ AN APPROVED EXTERIOR GRADE CAULK BY OTHERS (TYP.)
 3. WOOD BUCK SPECIFIC GRAVITY = 0.55 MIN.
 4. CONCRETE COMPRESSIVE STRENGTH = 2KSI MIN.
- * WHEN THE GAP BETWEEN THE WINDOW FRAME AND THE BUCK OR MASONRY IS LESS THAN 1/8", SHIMS ARE NOT REQUIRED.

ANCHORS NOTE:


ANCHORS TO BE #14 SMS OR WD. SCREWS INTO WOOD, OR 1/4' ITW BUILD EX TAPCONS OR APPROVED CONC. FASTENERS INTO CONCRETE (2KSI MIN.), WITH A MINIMUM OF 1 1/4' PENETRATION INTO WOOD OR CONC. AT 12" O.C. MAX.

* TAPCON YIELD STRENGTH: $F_y=100Ksi$
 ULTIMATE STRENGTH: $F_u=125Ksi$

ALL WOOD BUCKS IN CONTACT WITH CONCRETE (NOT BY LAWSON IND.) TO BE PRESSURE TREATED & TO BE REVIEWED BY BLDG. OFFICIAL (TYP.) (SEE GENERAL NOTES AT SHEET #1)

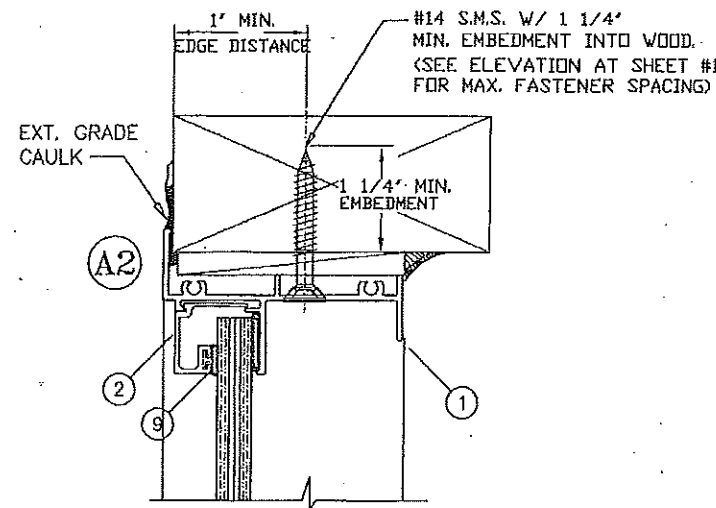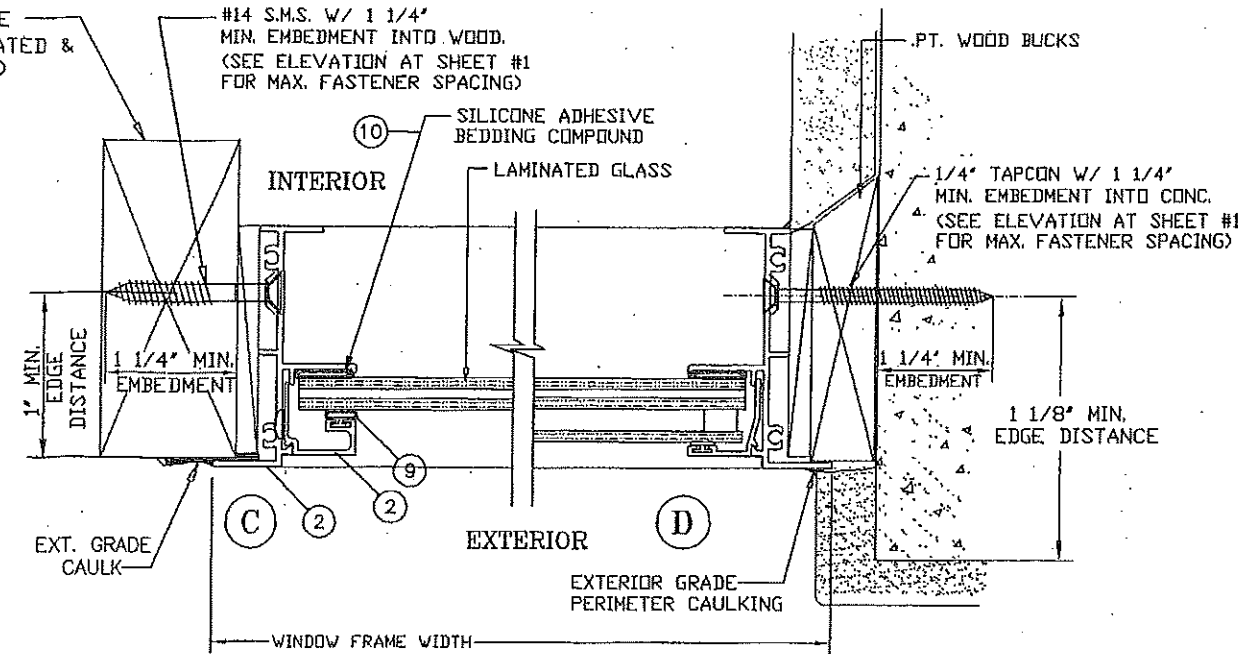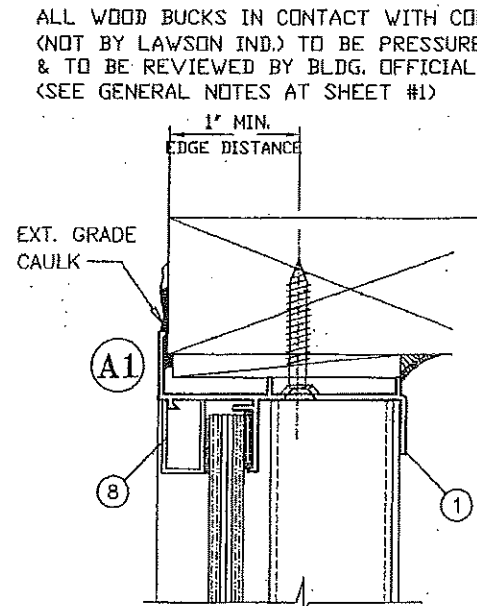

1/4' TAPCON W/ 1 1/4' MIN. EMBEDMENT INTO CONC. (SEE ELEVATION AT SHEET #1 FOR MAX. FASTENER SPACING)

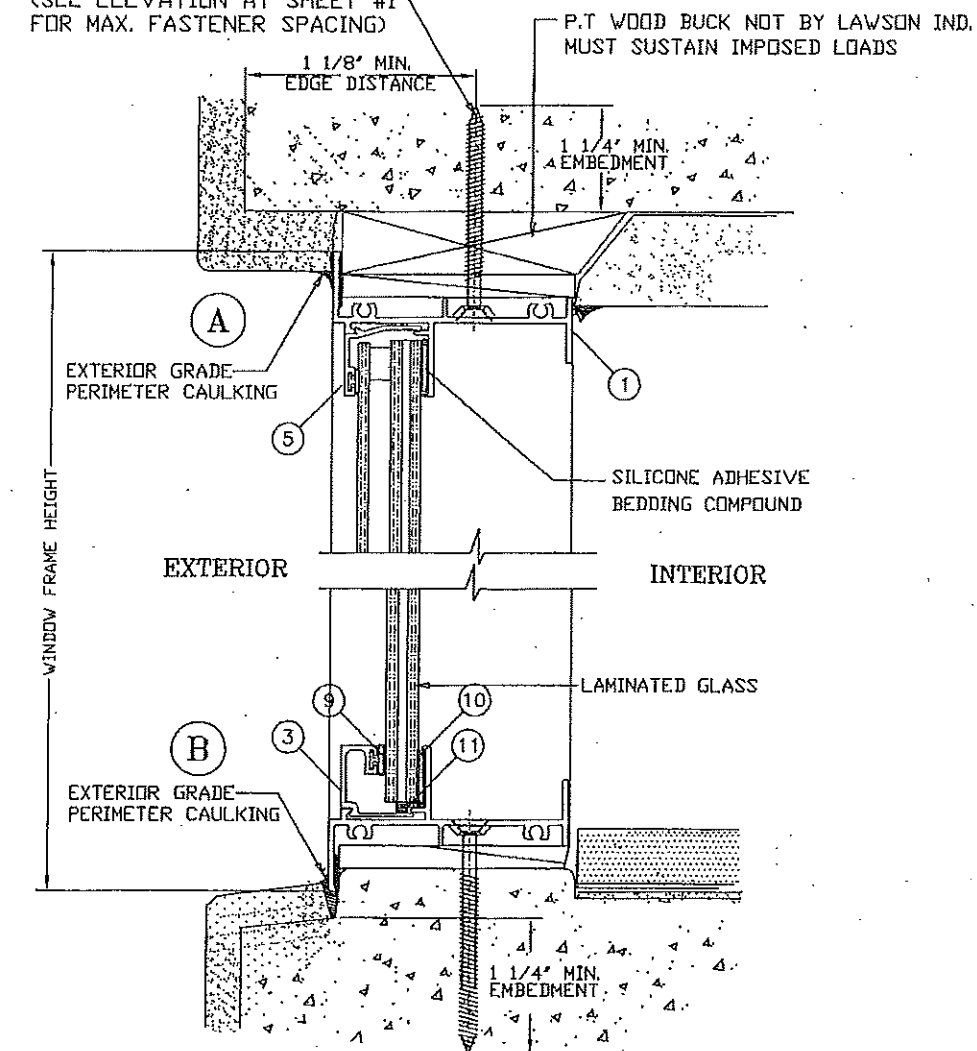


LAWSON INDUSTRIES, INC.

8501 N.W. 90 ST.
 MEDLEY, FLORIDA 33166
 PH No. (305) 696-8660

MANUFACTURER OF QUALITY ALUMINUM WINDOWS AND GLASS DOORS
 SERIES-4200-6200 FLANGE FRAME IMPACT FIXED WINDOW
 WINDOW VERTICAL AND HORIZONTAL CROSS SECTION, DETAILS & NOTES

| | | | |
|-----------------|---|---------------|----------|
| Revision Notes: | A. Revised date for the 2014, FBC | Date Drawn: | 02-21-12 |
| | B. Compliance w/ FBC 5th Edition (2014) and ASTM E1300-08 | Date Revised: | 05/12/17 |
| Drawn By: | N. ERAZO | Scale: | B |
| Reviewed By: | N. ERAZO | | |
| Revision Level: | B | | |

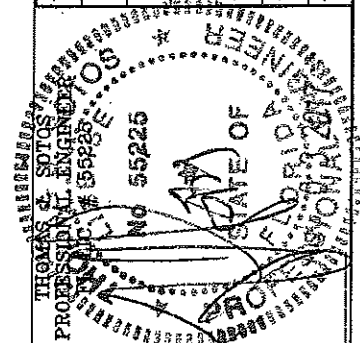

| LAMINATED INSULATED GLASS COMPOSITION TYPE B | | |
|--|---|--------|
| ITEM | DESCRIPTION | DETAIL |
| 1 | 1/8" ANN. GLASS | |
| 2 | 0.090" SAFLEX PVB by Eastman Chemical Co. | |
| 3 | 1/8" ANNEALED GLASS | |
| 4 | 1/4" INSULATED AIR SPACE | |
| 5 (*) | 1/8" ANNEALED OR TEMPERED GLASS | |

| LAMINATED INSULATED GLASS COMPOSITION TYPE C | | |
|--|---|--------|
| ITEM | DESCRIPTION | DETAIL |
| 1 | 1/8" ANNEALED GLASS | |
| 2 | 0.090" SAFLEX PVB by Eastman Chemical Co. | |
| 3 | 1/8" ANNEALED GLASS | |
| 4 | 1/4" INSULATED AIR SPACE | |
| 5 (*) | 3/16" ANNEALED OR TEMPERED GLASS | |


| LAMINATED INSULATED GLASS COMPOSITION TYPE F | | |
|--|--|--------|
| ITEM | DESCRIPTION | DETAIL |
| 1 | 1/8" HEAT-STRENGTHENED GLASS | |
| 2 | 0.090" TROSIFOL PVB by Kuraray America, Inc. | |
| 3 | 1/8" HEAT-STRENGTHENED GLASS | |
| 4 | 1/4" INSULATED AIR SPACE | |
| 5 (*) | 1/8" ANNEALED OR TEMPERED GLASS | |

| LAMINATED INSULATED GLASS COMPOSITION TYPE G | | |
|--|--|--------|
| ITEM | DESCRIPTION | DETAIL |
| 1 | 1/8" HEAT-STRENGTHENED GLASS | |
| 2 | 0.090" TROSIFOL PVB by Kuraray America, Inc. | |
| 3 | 1/8" HEAT-STRENGTHENED GLASS | |
| 4 | 1/4" INSULATED AIR SPACE | |
| 5 (*) | 3/16" ANNEALED OR TEMPERED GLASS | |

| LAMINATED INSULATED GLASS COMPOSITION TYPE L | | |
|--|--|--------|
| ITEM | DESCRIPTION | DETAIL |
| 1 | 3/16" HEAT-STRENGTHENED GLASS | |
| 2 | 0.090" TROSIFOL PVB by Kuraray America, Inc. | |
| 3 | 3/16" HEAT-STRENGTHENED GLASS | |
| 4 | 1/4" INSULATED AIR SPACE | |
| 5 | 3/16" TEMPERED GLASS | |

Notes:

- SEE SHEET 4 FOR DESIGN LOADS LOAD CAPACITY TABLES.
- WINDOWS WITH GLASS TYPES "B, C, F, OR G" INSTALLED ABOVE 30 FT. IN THE HVHZ, THE I.G. EXTERIOR LITE SHALL BE TEMPERED TO COMPLY WITH THE SMALL MISSILE IMPACT RESISTANCE REQUIREMENTS (FBC-2014, Section 2411.3.3.7).

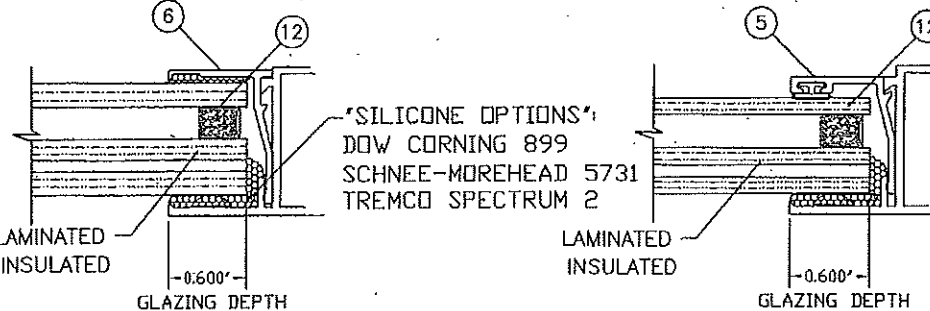

LAMINATED/INSULATED GLASS TYPICAL GLAZING DETAIL

| 5/16" LAMINATED GLASS COMPOSITION - TYPE A | | |
|--|--|--------|
| ITEM | GLASS DESCRIPTION | DETAIL |
| 1 | 1/8" ANNEALED GLASS | |
| 2 | 0.090" TROSIFOL PVB by Kuraray America, Inc. | |
| 3 | 1/8" ANNEALED GLASS | |

| 5/16" LAMINATED GLASS COMPOSITION - TYPE D | | |
|--|--|--------|
| ITEM | GLASS DESCRIPTION | DETAIL |
| 1 | 1/8" HEAT-STRENGTHENED GLASS | |
| 2 | 0.090" TROSIFOL PVB by Kuraray America, Inc. | |
| 3 | 1/8" HEAT-STRENGTHENED GLASS | |




| 13/32" LAMINATED GLASS COMPOSITION - TYPE E | | |
|---|---|--------|
| ITEM | GLASS DESCRIPTION | DETAIL |
| 1 | 3/16" HEAT-STRENGTHENED GLASS | |
| 2 | 0.090" SAFLEX PVB by Eastman Chemical Co. | |
| 3 | 1/8" HEAT-STRENGTHENED GLASS | |

| 7/16" LAMINATED GLASS COMPOSITION - TYPE H | | |
|--|---|--------|
| ITEM | GLASS DESCRIPTION | DETAIL |
| 1 | 3/16" ANNEALED GLASS | |
| 2 | 0.090" SAFLEX PVB by Eastman Chemical Co. | |
| 3 | 3/16" ANNEALED GLASS | |

| 7/16" LAMINATED GLASS COMPOSITION - TYPE I | | |
|--|--|--------|
| ITEM | GLASS DESCRIPTION | DETAIL |
| 1 | 3/16" ANNEALED GLASS | |
| 2 | 0.090" TROSIFOL PVB by Kuraray America, Inc. | |
| 3 | 3/16" ANNEALED GLASS | |

| 7/16" LAMINATED GLASS COMPOSITION - TYPE J | | |
|--|---|--------|
| ITEM | GLASS DESCRIPTION | DETAIL |
| 1 | 3/16" HEAT-STRENGTHENED GLASS | |
| 2 | 0.090" SENTRYGLASS by Kuraray America, Inc. | |
| 3 | 3/16" HEAT-STRENGTHENED GLASS | |

| 7/16" LAMINATED GLASS COMPOSITION - TYPE K | | |
|--|--|--------|
| ITEM | GLASS DESCRIPTION | DETAIL |
| 1 | 3/16" HEAT-STRENGTHENED GLASS | |
| 2 | 0.090" TROSIFOL PVB by Kuraray America, Inc. | |
| 3 | 3/16" HEAT-STRENGTHENED GLASS | |

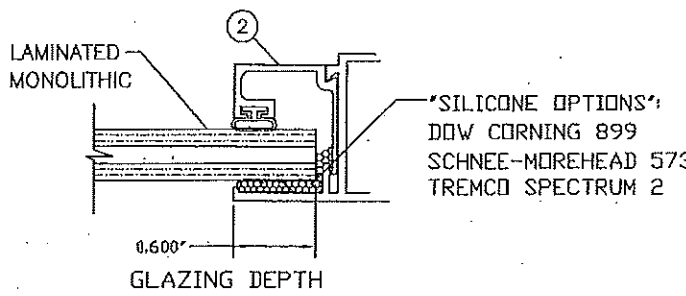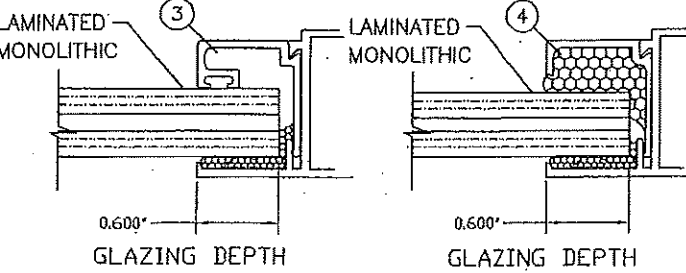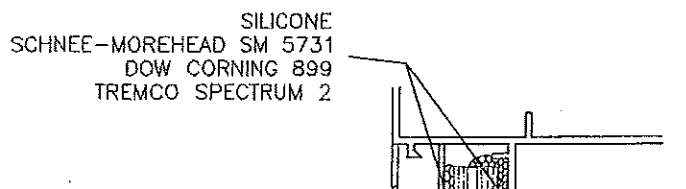

LAMINATED/MONOLITHIC GLASS TYPICAL GLAZING DETAIL


PRODUCT REVISED
as complying with the Florida Building Code
NOA-No. 17-0531.05
Expiration Date 08/22/2022
By _____
Miami-Dade Product Control

LAWSON INDUSTRIES, INC.
MANUFACTURER OF QUALITY ALUMINUM WINDOWS AND GLASS DOORS

8501 N.W. 90 ST.
MEDLEY, FLORIDA 33166
PH No. (305) 696-8660

SERIES-4200-6200 FLANGE FRAME IMPACT FIXED WINDOW
LAMINATED GLASS TYPES AND GLAZING DETAILS
Product Reference Number: LA200-6200-1201
Drawing Number: LA200-6200-1201
Sheet: 3 OF 5
Revision #: _____


| | | | |
|--|-------------------------------------|---------------------------------------|-------------|
| Revision Notes: A. Revised date for the 2014 FBC B. Compliance w/ FBC 5th Edition (2014) and ASTM E1300-09 | Date Drawn: N. ERAZO 02-21-12 | Date Revised: N. ERAZO 05/12/17 | Scale: B |
|--|-------------------------------------|---------------------------------------|-------------|

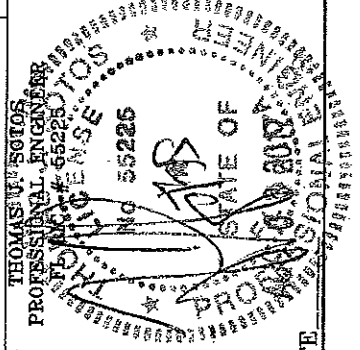

DATE


BILL OF MATERIALS

| ITEM | PART # | QUANTITY | DESCRIPTION | MATERIAL | REMARKS |
|------|----------------|-----------|--|------------|------------------|
| 1 | L-4201 | 2 | FRAME HEAD/SILL/JAMB | 6063-T6 | - |
| 2 | L-7708 | 4 | GLAZING BEAD (5/16" GLASS) | 6063-T6 | - |
| 3 | L-7708 | 4 | GLAZING BEAD (3/8" & 13/32" GLASS) | 6063-T6 | - |
| 4 | L-7708 TRIMMED | 4 | GLAZING BEAD (7/16" GLASS) | 6063-T6 | - |
| 5 | L-7711 | 4 | GLAZING BEAD (5/16" GLASS- INSULATED) | 6063-T6 | - |
| 6 | L-6211 | 4 | GLAZING BEAD (7/16" GLASS - INSULATED) | 6063-T6 | - |
| 7 | #8 X 3/4" | 2/ CORNER | ASSEMBLY SCREWS | - | P.H. PHILLIPS |
| 8 | L-4204 | AS REQD. | GLAZING BEAD AT CIRCULAR WDWS. | 6063-T5 | - |
| 9 | VWS-004 | AS REQD. | GLAZING GASKET | SOFT PVC | - |
| 10 | * | AS REQD. | GLAZING SILICONE | * | - |
| 11 | PL 75.6020 | AS REQD. | GLAZING SETTING BLOCK | SOFT PVC | 1/8" X 1/8" X 2" |
| 12 | 812-25H-357 | AS REQD. | "TruSeal" Dura Seal Swiggle Spacer | 1/4" BLACK | 1/4" AIR SPACE |

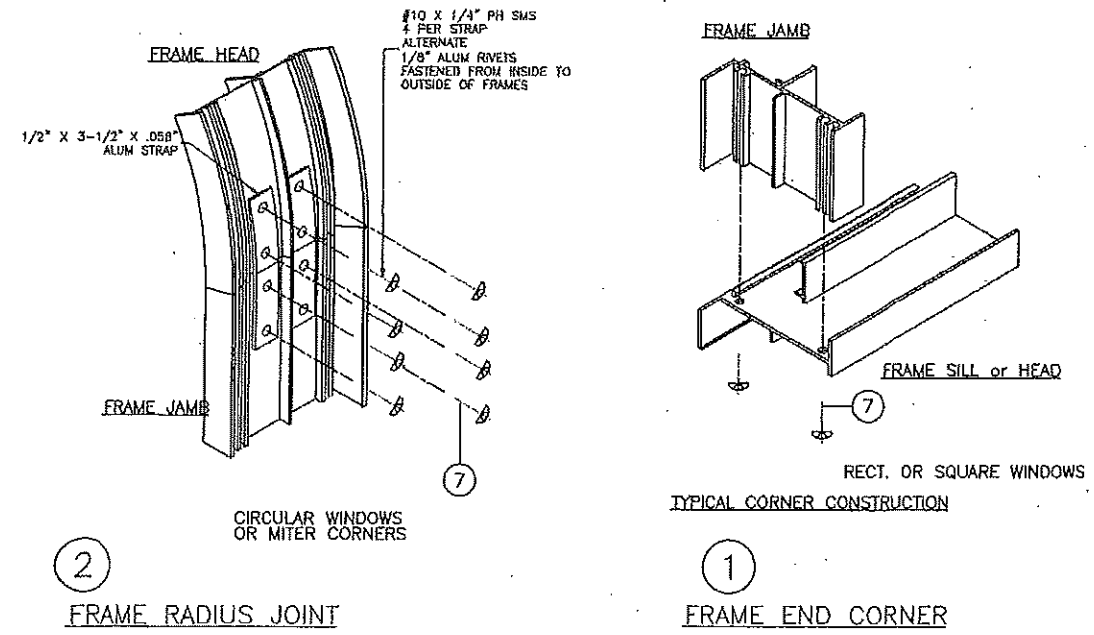


SEALANT:
 FRAME CORNERS, OR JOINTS SEALED WITH A COLORED SEALANT AND PERIMETER OF GLAZING BEAD WITH CLEAR SILICONE

WINDOW FRAME EXTRUSION DETAILS

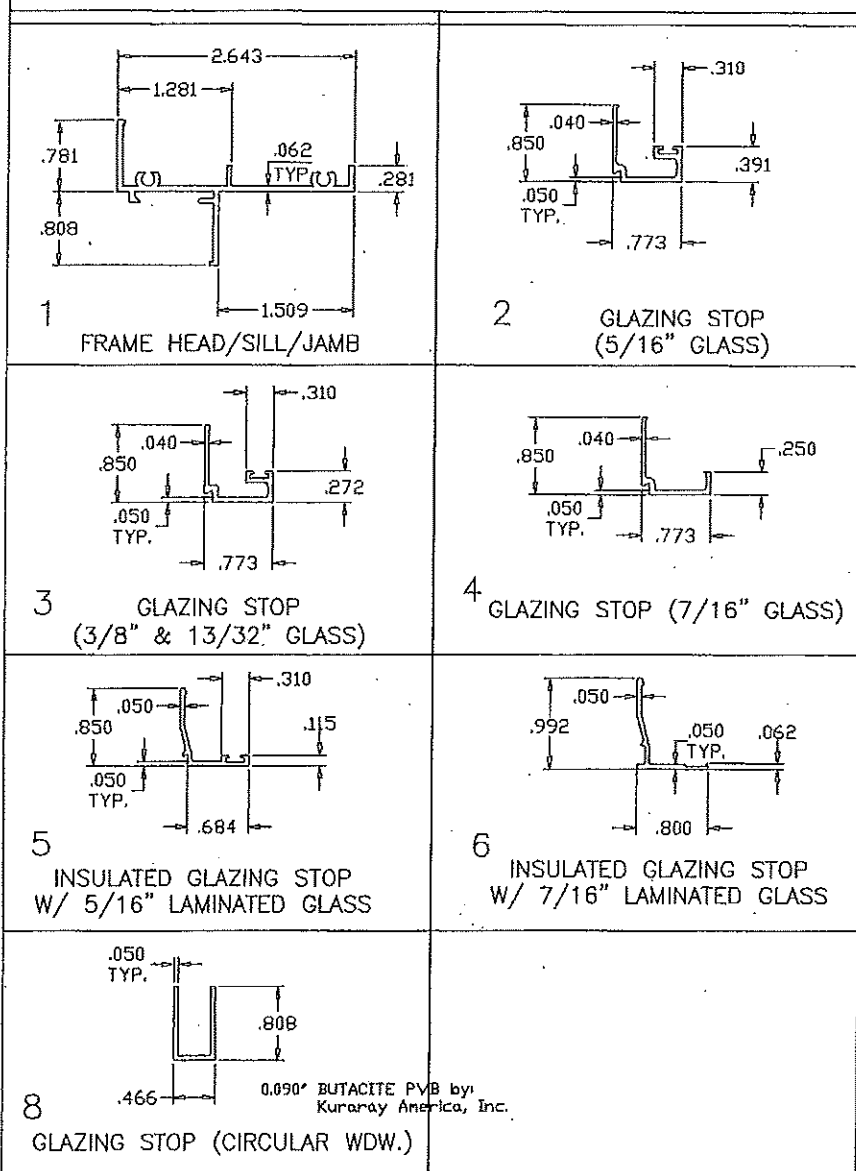


SEE MULLION APPROVALS FOR MULLION TYPE, SIZE AND MAX. DESIGN PRESSURE LIMITATIONS.
 ALUMINUM MULLION
 (ALUM. 0.078" MIN. THICK)

NOTE: THE LOWER PRESSURES OF THE WINDOW OR MULL SHALL GOVERN

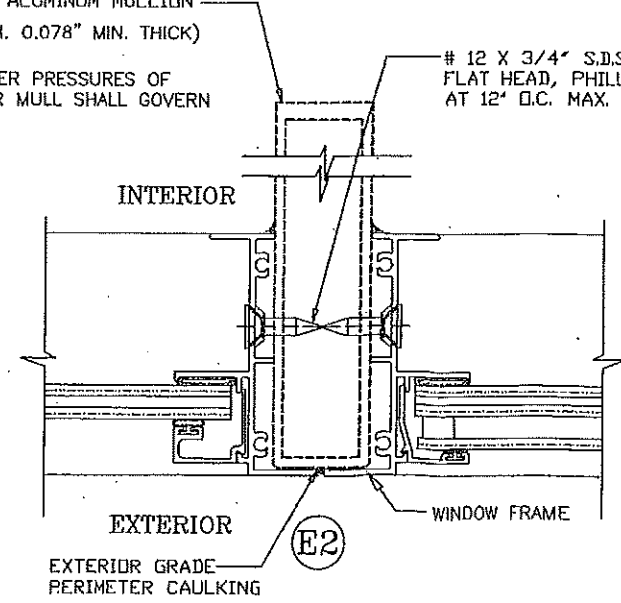

FRAME MULLING DETAIL

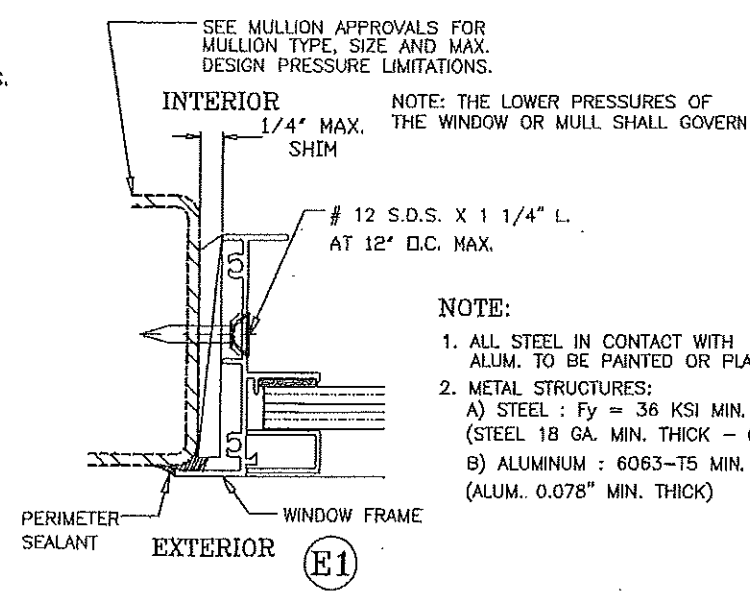

METAL STRUCTURE ATTACHMENT DETAIL

PRODUCT REVISED
 as complying with the Florida Building Code
 NOA-No. **17-0531.05**
 Expiration Date **08/22/2022**

By *[Signature]*
 Miami-Dade Product Control

LAWSON INDUSTRIES, INC.

8501 N.W. 90 ST.
 MEDLEY, FLORIDA 33166
 PH No. (305) 696-8660

MANUFACTURER OF QUALITY ALUMINUM WINDOWS AND GLASS DOORS
 SERIES-4200-6200 FLANGE FRAME IMPACT FIXED WINDOW
 BILL OF MATERIALS, EXTRUSION DETAILS & CORNER ASSEMBLY DETAILS

| | | | |
|--|-------------------------------------|---------------------------------------|-------------|
| Revision Notes: A. Revised date for the 2014 FBC B. Compliance w/ FBC 5th Edition (2014) and ASTM E1300-09 | Date Drawn: N. ERAZO 02-21-12 | Date Revised: N. ERAZO 05/12/17 | Scale: B |
|--|-------------------------------------|---------------------------------------|-------------|

